



**INSTYTUT TECHNIKI BUDOWLANEJ**  
PL 00-611 WARSZAWA  
ul. Filtrowa 1  
tel.: (+48 22) 825-04-71  
(+48 22) 825-76-55  
fax: (+48 22) 825-52-86  
[www.itb.pl](http://www.itb.pl)



Member of



[www.eota.eu](http://www.eota.eu)

## European Technical Assessment

**ETA-10/0102  
of 13/09/2019**

### General Part

**Technical Assessment Body issuing the European Technical Assessment**

Instytut Techniki Budowlanej

**Trade name of the construction product**

DGE 02 Sinto-ST-VE, DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES

**Product family to which the construction product belongs**

Bonded fasteners for use in concrete

**Manufacturer**

TECFI S.p.A.  
S.S. Appia KM 193  
81050 Pastorano (CE)  
Italy

**Manufacturing plant**

TECFI  
Manufacturing Plant A2

**This European Technical Assessment contains**

29 pages including 3 Annexes which form an integral part of this assessment

**This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of**

European Assessment Document EAD 330499-01-0601 "Bonded fasteners for use in concrete"

**This version replaces**

ETA-10/0102 issued on 15/05/2014

*This European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.*

*Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.*

## Specific Part

### 1 Technical description of the product

The DGE 02 Sinto-ST-VE, DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES are bonded fasteners (injection type) consisting of an injection mortar cartridge using an applicator gun equipped with a special mixing nozzle and steel element: commercial threaded rod of the sizes M8 to M30 with hexagon nut and washer or reinforcing bar (rebar) from Ø8 to Ø32 mm.

The steel element is placed into a drilled hole previously injected (using an applicator gun) with a mortar with a slow and slight twisting motion. The steel element is anchored by the bond between steel element, mortar and concrete.

An illustration and the description of the products are given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document (EAD)

The performances given in clause 3 are only valid if the anchors are used in compliance with the specifications and conditions given in Annex B.

The performances given in this European Technical Assessment are based on an assumed working life of the anchor of 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Performance of the product

##### 3.1.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to tension load and shear load (static and quasi static loading), displacements	See Annex C1 to C7
Characteristic resistance for seismic performance category C1	See Annex C8
Characteristic resistance for seismic performance category C2	See Annex C9

##### 3.1.2 Hygiene, health and the environment (BWR 3)

No performance assessed.

#### 3.2 Methods used for the assessment

The assessment of the products has been made in accordance with the EAD 330499-01-0601 „Bonded fasteners for use in concrete”.

**4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**


According to Decision 96/582/EC of the European Commission the system 1 of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) applies.

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document (EAD)**


Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Instytut Techniki Budowlanej.

For type testing the results of the tests performed as part of the assessment for the European Technical Assessment shall be used unless there are changes in the production line or plant. In such cases the necessary type testing has to be agreed between Instytut Techniki Budowlanej and the notified body.

Issued in Warsaw on 13/09/2019 by Instytut Techniki Budowlanej



Krzysztof Kuczyński, PhD  
Deputy Director of ITB

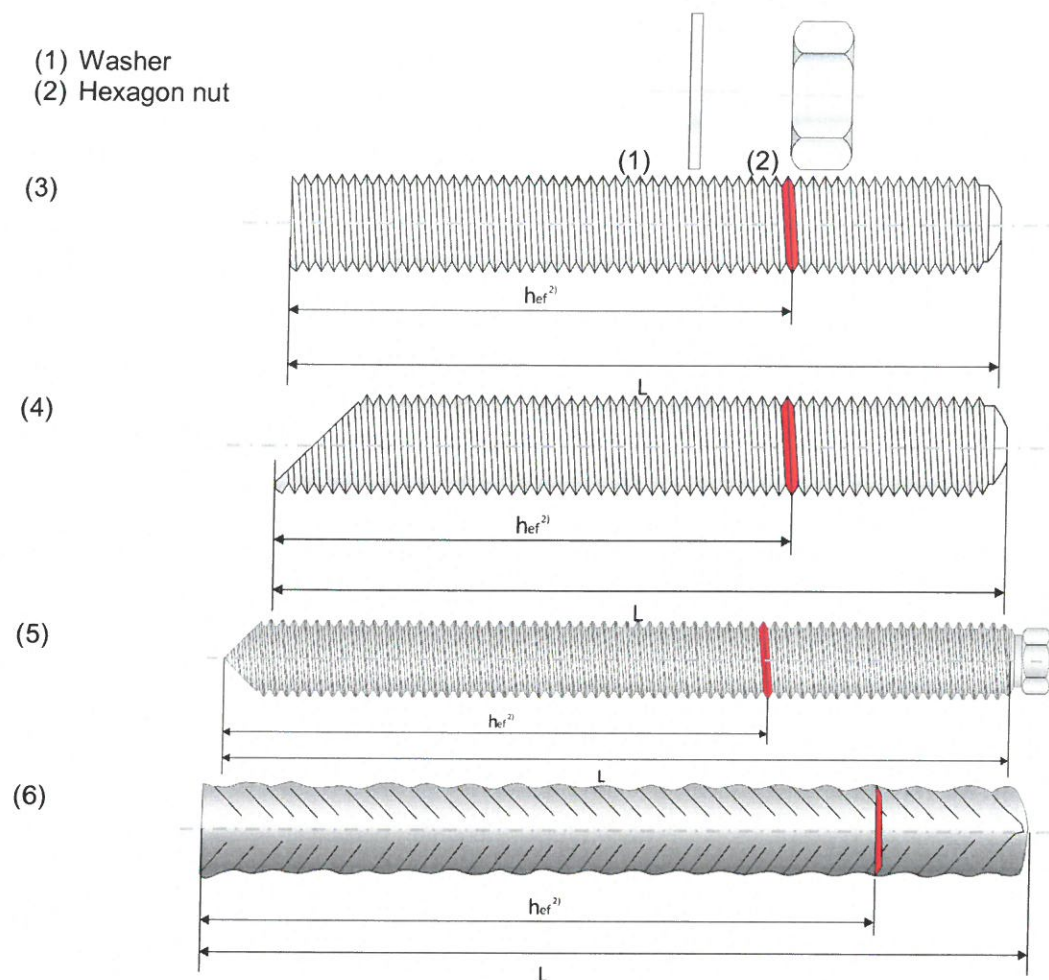

- (3) Flat end rod (with or without chamfer) with mark of embedment depth  
 (4) 45° end rod with mark of embedment depth  
 (5) V shape end rod (with or without driving end) with mark of embedment depth  
 (6) Rebar – Deformed reinforcing bar with mark of embedment depth

<sup>1)</sup> Marking according to clause 1.1 of EAD 330499-01-0601

<sup>2)</sup> Effective anchorage depth according to Table B1 and B2 (Annex B2 and B3)

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Product description**  
Steel elements

**Annex A1**  
of European  
Technical Assessment  
ETA-10/0102

**Table A1: Threaded rods**

Designation		Material			
Steel, zinc plated: electroplated ≥ 5 μm acc. to EN ISO 4042 hot-dip galvanized ≥ 40 μm acc. to EN ISO 1461					
Threaded rod	Property class	Characteristic steel ultimate strength	Characteristic steel yield strength	Fracture elongation	EN ISO 898-1
	4.8	$f_{uk} \geq 400 \text{ N/mm}^2$	$f_{yk} \geq 320 \text{ N/mm}^2$	$A_5 > 8\%^{1)}$	
	5.8	$f_{uk} \geq 500 \text{ N/mm}^2$	$f_{yk} \geq 400 \text{ N/mm}^2$	$A_5 > 8\%^{1)}$	
	8.8	$f_{uk} \geq 800 \text{ N/mm}^2$	$f_{yk} \geq 640 \text{ N/mm}^2$	$A_5 \geq 12\%^{1)}$	
	10.9	$f_{uk} \geq 1000 \text{ N/mm}^2$	$f_{yk} \geq 900 \text{ N/mm}^2$	$A_5 > 9\%^{1)}$	
Hexagon nut	4	for class 4.8 rods			EN 898-2
	5	for class 5.8 rods			
	8	for class 8.8 rods			
	10	for class 10.9 rods			
Washer	Steel, according to EN ISO 7089; corresponding to anchor rod material				
Stainless steel A2 (Materials) 1.4301, 1.4307, 1.4567, 1.4541					
Stainless steel A4 (Materials) 1.4401, 1.4404, 1.4571, 1.4362, 1.4578					
High corrosion resistance stainless steel (HCR) (Materials) 1.4529, 1.4565					
Threaded rod	Property class	Characteristic steel ultimate strength	Characteristic steel yield strength	Fracture elongation	EN 10088 EN ISO 3506
	50	$f_{uk} \geq 500 \text{ N/mm}^2$	$f_{yk} \geq 210 \text{ N/mm}^2$	$A_5 > 8\%^{1)}$	
	70	$f_{uk} \geq 700 \text{ N/mm}^2$	$f_{yk} \geq 450 \text{ N/mm}^2$	$A_5 \geq 12\%^{1)}$	
	80	$f_{uk} \geq 800 \text{ N/mm}^2$	$f_{yk} \geq 600 \text{ N/mm}^2$	$A_5 \geq 12\%^{1)}$	
Hexagon nut	50	for class 50 rods			EN 10088 EN ISO 3506
	70	for class 70 rods			
	80	for class 80 rods			
Washer	Steel, according to EN 10088; corresponding to anchor rod material				

<sup>1)</sup> For seismic performance category C1 and C2,  $A_5 > 19\%$

Commercial standard threaded rods may be used, with:

- material and mechanical properties according to Table A3,
- confirmation of material and mechanical properties by inspection certificate 3.1 according to EN-10204:2004,
- marking of the threaded rod with the embedment depth.

Note: Commercial standard threaded rods made of galvanized steel with property class above 8.8 are not permitted in some Member States.

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Product description**  
Materials (1)

**Annex A2**  
of European  
Technical Assessment  
ETA-10/0102

**Table A2: Reinforcing bars (Rebar)**

Designation	Material
Rebar according to EN 1992-1-1:2004+AC:2010	Bars and de-coiled rods Class B or C With $f_{yk}$ and $k$ according to EN 1992-1-1:2004+AC:2010 $f_{uk} = f_{tk} = k \times f_{yk}$ Rib height of the bar ( $h$ ) in the range $0,05d \leq h \leq 0,07d$

**Table A3: Injection mortars**

Product	Composition
DGE 02 Sinto-ST-VE DGE 12 Sinto-ST-VEW DGE 22 Sinto-ST-VES (two component injection mortars)	Additive: quartz Bonding agent: vinyl ester resin styrene free Hardener: dibenzoyl peroxide

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Product description**  
Materials (2)

**Annex A3**  
of European  
Technical Assessment  
ETA-10/0102

**Coaxial cartridge – size from 75 ml to 420 ml**



**Side by side cartridge – size from 345 ml to 825 ml**



**CIC foil cartridge – size from 165 ml to 300 ml**




**Coaxial peeler cartridge – size of 280 ml**



On the labels there all relevant information information regarding item code, batch number, trade name, processing note for installation, gel time and curing time related to the concrete temperature, hazard pictograms, expiration date and storage conditions.

**MIXER – the mixer is suitable for all type of cartridges**

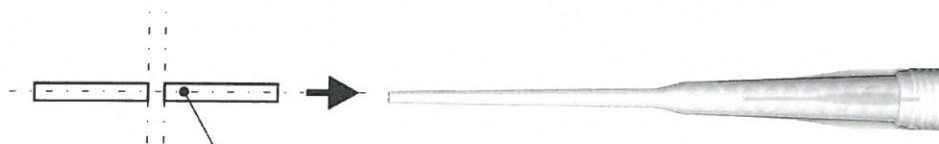

additional mixer extension, variable length between 300 mm up to 1000 mm

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Product description**  
Cartridge types and sizes

**Annex A4**  
of European  
Technical Assessment  
ETA-10/0102

## Specifications of intended use

### Use:

The anchors are intended to be used for anchorages for which requirements for mechanical resistance and stability and safety in use in the sense of the Basic Requirement 1 (EU) 305/2011 shall be fulfilled and failure of anchorages made with these products would compromise the stability of the works, cause risk to human life and/or lead to considerable economic consequences.

### Anchor subject to:

Static and quasi-static loads: sizes from M8 to M30 and from Ø8 to Ø32.

Seismic performance category C1: sizes from M12 to M20, rods with  $f_{uk} \leq 800 \text{ N/mm}^2$  and fracture elongation  $A_5 \geq 19\%$ .

Seismic performance category C2: sizes M12 and M16, rods with  $f_{uk} \leq 800 \text{ N/mm}^2$  and fracture elongation  $A_5 \geq 19\%$ .

### Base material:

- Reinforced or unreinforced normal weight concrete of strength class C20/25 at minimum to C50/60 at maximum according to EN 206-1206-1:2013+A1:2016.
- Non-cracked concrete: sizes from M8 to M30 and from Ø8 to Ø32.
- Cracked concrete: sizes from M10 to M20.

### Temperature range:

The anchors may be used in the following temperature range:

- -40°C to +40°C (max. short term temperature +40°C and max. long term temperature +24°C).
- -40°C to +80°C (max. short term temperature +80°C and max. long term temperature +50°C).
- -40°C to +120°C (max. short term temperature +120°C and max. long term temperature +72°C).

### Use conditions (environmental conditions):

- X1: Structures subject to dry internal conditions: Elements made of galvanized steel (zinc plated or hot dip galvanized) and stainless steel A2, A4 or high corrosion resistance steel (HCR).
- X2: Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if no particular aggressive conditions exist: Elements made of stainless steel A4 or high corrosion resistance steel (HCR).
- X3: Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if other particular aggressive conditions exist. Such particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used): Elements made of high corrosion resistant steel (HCR).

### Installation:

- Dry or wet concrete (use category I1): sizes from M8 to M30 and from Ø8 to Ø32.
- Flooded holes with the exception of seawater (use category I2): sizes from M8 to M30 and from Ø8 to Ø32.
- Installation direction D3 (downward and horizontal and upwards installation): sizes from M8 to M30 and from Ø8 to Ø32.
- The anchors are suitable for hammer drilled holes (HD), for hollow drill bit (HDB) and for compressed air drill (CA): sizes from M8 to M30 and from Ø8 to Ø32.


### Design methods:

- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Anchorages under static or quasi-static loads are designed in accordance to EN 1992-4:2018 and Technical Report TR 055.
- Anchorages under seismic actions are designed in accordance to EN 1992-4:2018 and Technical Report TR 045.

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Intended use  
Specifications**

**Annex B1  
of European  
Technical Assessment  
ETA-10/0102**

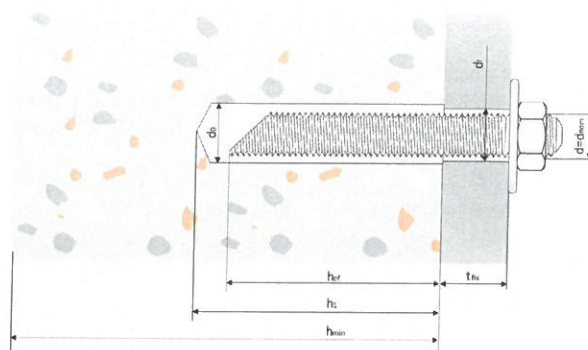
**Table B1: Installation data for threaded rods**

Size		M8	M10	M12	M16	M20	M24	M27	M30
Nominal drilling diameter	$d_0$ [mm]	10	12	14	18	24	28	30	35
Maximum diameter hole in the fixture	$d_{fix}$ [mm]	9	12	14	18	22	26	30	33
Effective embedment depth	$h_{ef,min}$ [mm]	60	70	80	100	120	145	145	145
	$h_{ef,max}$ [mm]	160	200	240	320	400	480	540	600
Depth of the drilling hole	$h_1$ [mm]	$h_{ef} + 5 \text{ mm}$							
Minimum thickness of the concrete slab	$h_{min}$ [mm]	$h_{ef} + 30 \text{ mm}; \geq 100 \text{ mm}$				$h_{ef} + 2d_0$			
Maximum setting torque moment	$T_{fix}$ [N·m]	10	20	40	80	130	200	250	280
Thickness to be fixed	$t_{fix,min}$ [mm]	$> 0$							
	$t_{fix,max}$ [mm]	$< 1500$							
Minimum spacing	$s_{min}$ [mm]	40	50	60	75	100	115	120	140
Minimum edge distance	$c_{min}$ [mm]	40	50	60	75	100	115	120	140

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Intended use**  
Installation data for threaded rods

**Annex B2**  
of European  
Technical Assessment  
ETA-10/0102

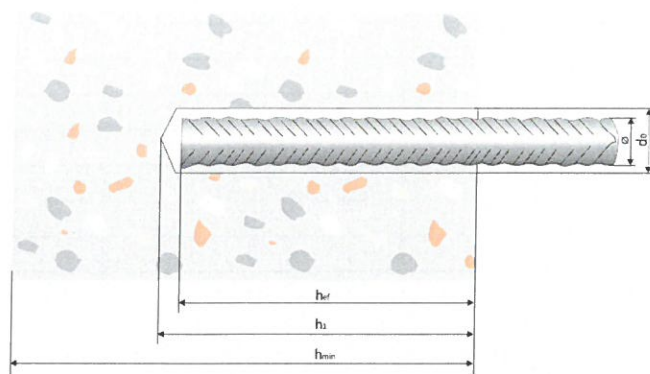**Table B2: Installation data for rebar**

Size		Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø28	Ø32
Nominal drilling diameter	$d_0$ [mm]	10 <sup>1)</sup> 12 <sup>1)</sup>	12 <sup>1)</sup> 14 <sup>1)</sup>	14 <sup>1)</sup> 16 <sup>1)</sup>	18	20	25	30	35	40
Effective embedment depth	$h_{ef,min}$ [mm]	60	70	80	80	100	120	150	180	200
	$h_{ef,max}$ [mm]	160	200	240	280	320	400	500	560	640
Depth of the drilling hole	$h_1$ [mm]	$h_{ef} + 5 \text{ mm}$								
Minimum thickness of the concrete slab	$h_{min}$ [mm]	$h_{ef} + 30 \text{ mm};$ $\geq 100 \text{ mm}$			$h_{ef} + 2d_0$					
Minimum spacing	$s_{min}$ [mm]	50	60	65	75	80	100	120	140	160
Minimum edge distance	$c_{min}$ [mm]	50	60	65	75	80	100	120	140	160

<sup>1)</sup> Each of two given values can be used

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Intended use**  
Installation data for rebar

**Annex B3**  
of European  
Technical Assessment  
ETA-10/0102

**Table B3: Maximum processing time and minimum curing time**

<b>DGE 02 Sinto-ST-VE (standard version)</b>		
<b>Concrete temperature [C°]</b>	<b>Processing time [min.]</b>	<b>Minimum curing time<sup>1)</sup> [min.]</b>
-10	105	1440
-5	65	840
0	45	420
+5	25	90
+10	16	60
+15	11,5	45
+20	7,5	40
+25	5	35
+30	3	30
+35	2	25
+40	1	20
<b>DGE 12 Sinto-ST-VEW (version for winter season)</b>		
<b>Concrete temperature [C°]</b>	<b>Processing time [min.]</b>	<b>Minimum curing time<sup>1)</sup> [min.]</b>
-20	120	2880
-15	90	1500
-10	60	900
-5	40	315
0	25	100
+5	15	70
+10	10	50
+15	7	35
+20	5	30
<b>DGE 22 Sinto-ST-VES (version for summer season)</b>		
<b>Concrete temperature [C°]</b>	<b>Processing time [min.]</b>	<b>Minimum curing time<sup>1)</sup> [min.]</b>
+20	14	60
+25	11	50
+30	8	40
+35	6	30
+40	4	20


<sup>1)</sup> The minimum time from the end of the mixing to the time when the anchor may be torque or loaded (whichever is longer). Cartridge temperature from +5°C to +30°C. Minimum cartridge temperature of +15°C for application where the concrete temperature is below 0°C.  
For wet condition and flooded holes the curing time must be double.

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Intended use**  
Maximum processing time and minimum curing time


**Annex B4**  
of European  
Technical Assessment  
ETA-10/0102

Manual Blower pump of cleaning operation: minimum nominal dimensions

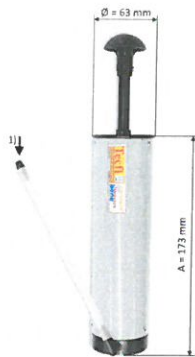

To extend the length of the blowing nozzle is it possible to use the mixer extension with the manual blowing pump (position to insert the mixer extension is reported as 1)).

Is it possible to blow the drilled hole using compressed oil-free air, also with the mixer extension (position to insert the mixer extension is reported as 1)). The minimum pressure is 6 bar, the minimum flow of air is 6 m<sup>3</sup>/h. A gun with a blowing orifice of 3,5 mm is required.

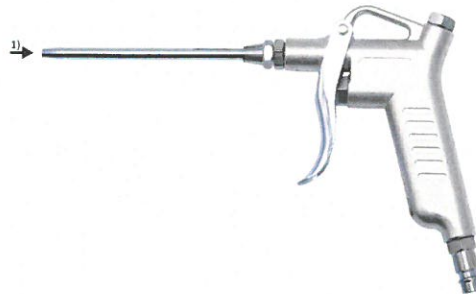

Mixer extension (from 380 mm to 1000 mm) with nominal diameter 8 or 10 mm

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Intended use**  
Cleaning tools (1)

**Annex B5**  
of European  
Technical Assessment  
ETA-10/0102

**Table B4: Standard brush diameter for threaded rods**

Threaded rod diameter		M8	M10	M12	M16	M20	M24	M27	M30
$d_0$	Nominal drill hole [mm]	10	12	14	18	24	28	30	35
$d_b$	Brush diameter [mm]	12	14	16	20	26	30	35	37

**Table B5: Standard brush diameter for rebar**

Rebar diameter		Ø8		Ø10		Ø12		Ø14
$d_0$	Nominal drill hole [mm]	10 <sup>1)</sup>	12 <sup>1)</sup>	12 <sup>1)</sup>	14 <sup>1)</sup>	14 <sup>1)</sup>	16 <sup>1)</sup>	18
$d_b$	Brush diameter [mm]	12	14	14	16	16	18	20

<sup>1)</sup> Each of two given values can be used


**Table B6: Special brush diameter (mechanical brush) for threaded rods**

Threaded rod diameter		M16	M20	M24	M27	M30
$d_0$	Nominal drill hole [mm]	18	24	28	30	35
$d_b$	Brush diameter [mm]	20	26	30	32	37

**Table B7: Special brush diameter (mechanical brush) for rebar**

Threaded rod diameter		Ø8		Ø10		Ø12		Ø14	Ø16	Ø20	Ø25	Ø28	Ø32
$d_0$	Nominal drill hole [mm]	10 <sup>1)</sup>	12 <sup>1)</sup>	12 <sup>1)</sup>	14 <sup>1)</sup>	14 <sup>1)</sup>	16 <sup>1)</sup>	18	20	25	30	35	40
$d_b$	Brush diameter [mm]	12	14	14	16	16	18	20	22	27	32	37	42

<sup>1)</sup> Each of two given values can be used

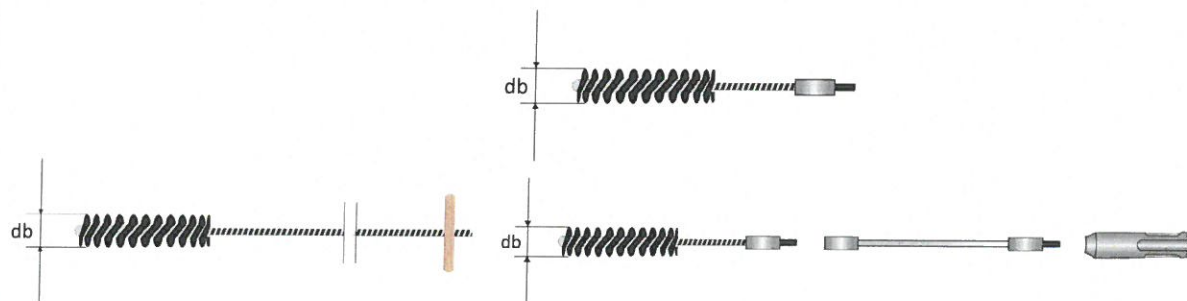

Standard brush with steel bristle, steel stem and wood handle

Special (mechanical) brush with steel bristle, steel stem, threaded connection for extension or for connection to SDS adaptor

DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES


Intended use  
Cleaning tools (2)

Annex B6  
of European  
Technical Assessment  
ETA-10/0102

### Hollow Drill Bit (HDB)

The hollow drill bit cleaning is applicable to hammer drilling method; this system is intended to remove dust during the drilling operation if used according to the manufacturer specifications.

The drilling system consists of a special hollow drill bit and a vacuum cleaner. A suitable dust extraction system must be used (e.g. Bosh GAS 35 M AFC or similar system with comparable performance data).

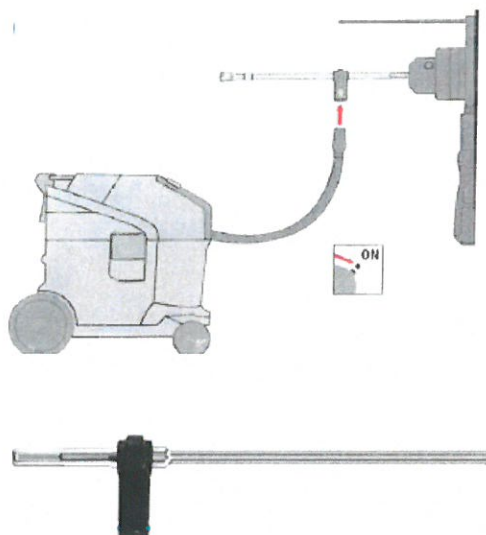

It is mandatory to switch on the vacuum cleaner before starting the drilling operations

**Table B8: HDB perforation diameter for threaded rods**

Threaded rod diameter		M8	M10	M12	M16	M20	M24	M27	M30
d <sub>0</sub>	Nominal drill hole [mm]	10	12	14	18	24	28	30	35

**Table B9: HDB perforation diameter for rebar**

Rebar diameter		Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø28
d <sub>0</sub>	Nominal drill hole [mm]	10 <sup>1)</sup> 12 <sup>1)</sup>	12 <sup>1)</sup> 14 <sup>1)</sup>	14 <sup>1)</sup> 16 <sup>1)</sup>	18	20	25	30	35


<sup>1)</sup> Each of two given values can be used

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**


**Intended use**  
Hollow drill bit (HDB) specification

**Annex B7**  
of European  
Technical Assessment  
ETA-10/0102

**Use the mixer extension (assembled on the standard mixer) for the injection up to 300 mm if necessary.**

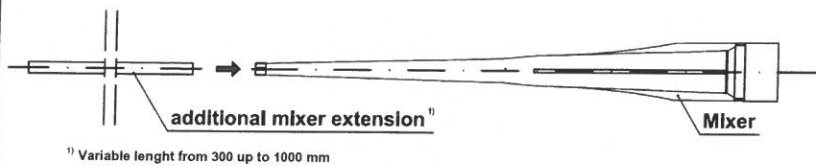

**Use this system for special conditions.**

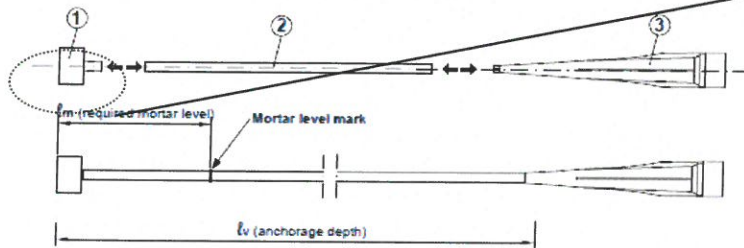


- ① Injection plug (nominal diameter according to the nominal diameter of drilled hole)
- ② Special mixer extension (variable length with external diameter 10 mm)  
Mark the required mortar level  $l_m$  and embedment depth  $l_v$  with tape or marker on the injection extension. Quick estimation:  $l_m = 1/3 \cdot l_v$   
Continue injection until the mortar level mark  $l_m$  becomes visible.
- ③ Mixer (suitable for all size of cartridge)


These tools allow the application in special conditions:

- installation with anchorage depth greater than 300 mm;
- overhead installation.

For these applications it is recommended the use of pneumatic or battery dispenser.




Insert the special mixer extension in the inner diameter of the injection plug up to reach the top of the plug



#### System assembled

- ① Injection plug
- ② Special mixer extension
- ③ Mixer
- ④ Cartridge
- ⑤ Sample of dispenser

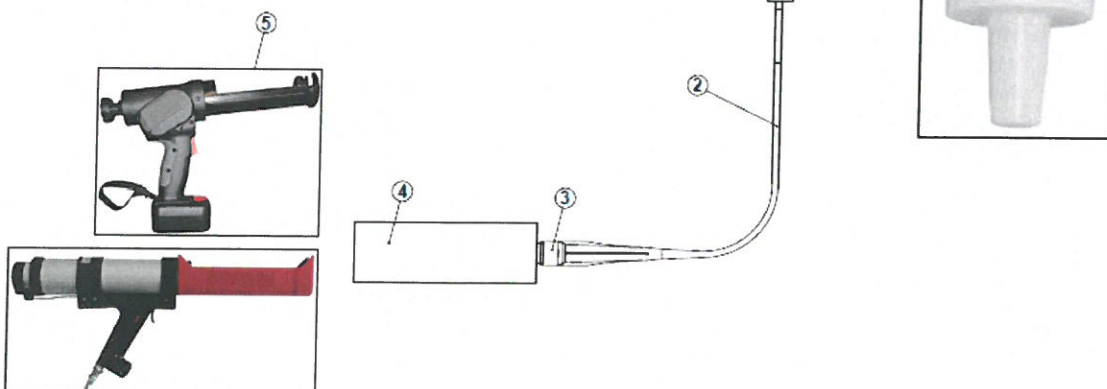







**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Intended use**  
Tools for installation (1)

**Annex B8**  
of European  
Technical Assessment  
ETA-10/0102








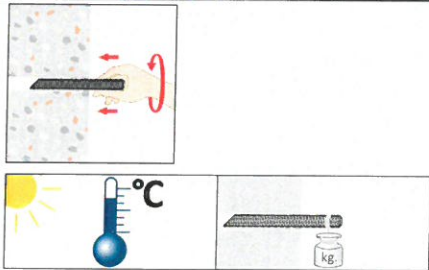
**Table B10: Mortar injection pumps**




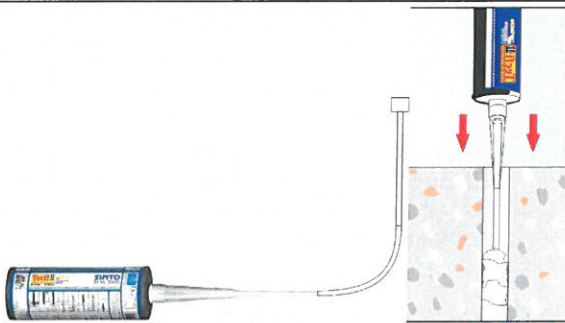
<b>Pumps (injection dispensers)</b>	<b>Cartridges</b>	<b>Types</b>
 <i>Manual</i>	420 ml 400 ml 380 ml	Manual (up to 300 mm anchorage depth)
 <i>Manual</i>	345 ml 300 ml 280 ml 165 ml	Manual (up to 300 mm anchorage depth)
 <i>Manual</i>	300 ml 280 ml 165 ml	Manual (up to 300 mm anchorage depth)
 <i>Pneumatic</i>	825 ml	Pneumatic (up to 640 mm anchorage depth)
 <i>Pneumatic</i>	420 ml 400 ml 380 ml	Pneumatic (up to 640 mm anchorage depth)
 <i>Battery</i>	420 ml 400 ml 380 ml 345 ml 300 ml	Battery (up to 640 mm anchorage depth)

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**





**Intended use**  
Tools for installation (2)

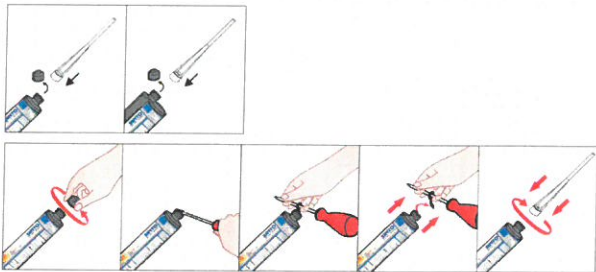**Annex B9**  
of European  
Technical Assessment  
ETA-10/0102

1		Drill the hole with the correct diameter and depth using a rotary percussive machine. Check the perpendicularity of the hole during the drilling operation. <b>In case of use of hollow drill bit (Annex B7) proceed directly to the clause 3.</b>
2	<div><div><p>4x blower manual pump</p></div><div><p>4x standard brush</p></div><div><p>4x blower manual pump</p></div></div> <p>if necessary use a mixer extension for the blower operation (see Annex B5)</p>	Clean the hole from drilling dust: the hole shall be cleaned by at least 4 blowing operations, by at least 4 brushing operations followed again by at least 4 blowing operations; before brushing clean the brush and check (see Annex B6, standard brush) if the brush diameter is sufficient. For the blower tools see Annex B5.
3		For coaxial, peeler and side by side cartridges unscrew the front cup, screw on the mixer and insert the cartridge into the gun. For CIC sizes, unscrew the front cup, pull-out the steel closing clip according to the following operation: 1) Insert the mixer in the eye of the plastic extractor; 2) Pull the extractor to unhook the steel closing clip of the foil. In the version without the extractor cut the foil pack. After that screw on the mixer and insert the cartridge in the gun.
4		Before starting to use the cartridge, eject a first part of the product, being sure that the two components are completely mixed. The complete mixing is reached only after that the product, obtained by mixing the two components, comes out from the mixer with a uniform colour.
5	 <p>if necessary, use a mixer extension for the injection (see Annex B8)</p>	Fill the drilled hole uniformly starting from the drilled hole bottom, in order to avoid entrapment of the air; remove the mixer slowly bit by bit during pressing-out; filling the drill hole with a quantity of the injection mortar corresponding to 2/3 of the drill hole depth.
6	<div><p><b>ATTENTION:</b> Steel elements dry and free oil and other contaminants</p></div>	Insert immediately the steel element (threaded rod or rebar), marked according to the proper anchorage depth, slowly and with a slight twisting motion, removing excess of injection mortar around the steel element. Observe the processing time according Annex B4. Wait the curing time according Annex B4.
<div><div><div>DGE 02 Sinto-ST-VE, DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES</div><div>Intended use Installation instruction up to 300 mm depth</div></div><div>Annex B10 of European Technical Assessment ETA-10/0102</div></div>		

1	See clause 1 Annex B10. In case of use of hollow drill bit (HDB) proceed directly to the clause 3.	
2	<div><div></div><div></div><div></div><div>Compressed air free from oil or lubricants</div></div> <td><p>Clean the hole from drilling dust:</p><p>the hole shall be cleaned by at least 4 blowing operations (5 seconds for single operation) with compressed air, by at least 4 brushing operations with special brush followed again by at least 4 blowing operations (5 seconds for single operation) with compressed air. Before brushing clean the brush and check if the brush diameter is sufficient.</p></td>	<p>Clean the hole from drilling dust:</p> <p>the hole shall be cleaned by at least 4 blowing operations (5 seconds for single operation) with compressed air, by at least 4 brushing operations with special brush followed again by at least 4 blowing operations (5 seconds for single operation) with compressed air. Before brushing clean the brush and check if the brush diameter is sufficient.</p>
3	See clause 3 Annex B10	
4	See clause 4 Annex B10	
5		<p>Before starting the injection, assemble the system according to Annex B8. After that, fill the drilled hole uniformly from the drilled hole bottom, in order to avoid entrapment of the air; remove the special mixer extension with injection plug slowly bit by bit during pressing-out; filling the drill hole with a quantity of the injection mortar corresponding to 2/3 of the drill hole depth.</p> <p>Procedure for overhead installation are detailed in Annex B12.</p>
6	See clause 6 Annex B10	

<p><b>DGE 02 Sinto-ST-VE, DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES</b></p>	<p><b>Annex B11</b> of European Technical Assessment ETA-10/0102</p>
<p><b>Intended use</b> Installation instruction up to 640 mm depth</p>	

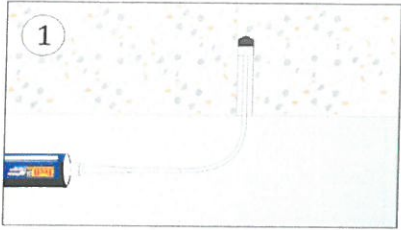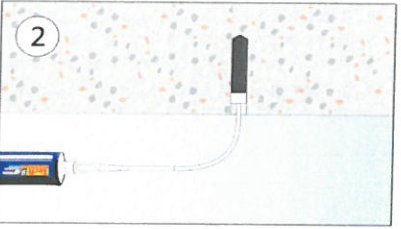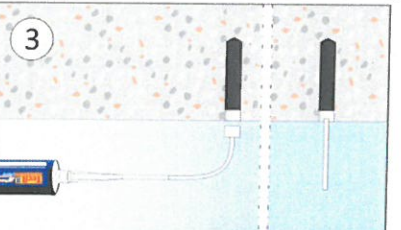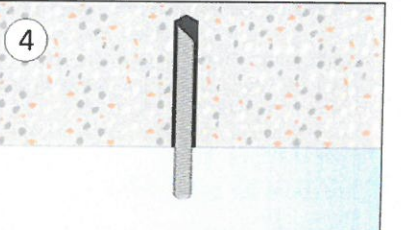	<p>Start injection: Inject from the bottom of the hole using the proper pneumatic-pump. Hold this position during the injection phase.</p>
	<p>Injection phase: inject the product about 2/3 of the hole depth. During the injection hold this position to assure the correct installation.</p>
	<p>End injection: remove the injection plug. Insert immediately the rod (turn the rod during the insertion).</p>
	<p>End installation: to avoid the slipping of the rod during the open time of the product (due to the rod own weight) use a temporary interlocking element (e.g. wedge of wood).</p>

Observe the open time and wait the curing time according to Annex B4

<p><b>DGE 02 Sinto-ST-VE, DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES</b></p>	<p><b>Annex B12</b>  of European Technical Assessment ETA-10/0102</p>
<p><b>Intended use</b> Overhead installation instruction</p>	

**Table C1: Characteristic values for steel tension resistance and steel shear resistance – threaded rods.**

Size			M8	M10	M12	M16	M20	M24	M27	M30
<b>Steel failure – characteristic tension resistance</b>										
Steel class 4.8	$N_{Rk,s}$	[kN]	15	23	34	63	98	141	183	224
Steel class 5.8	$N_{Rk,s}$	[kN]	18	29	42	78	122	176	229	280
Steel class 8.8	$N_{Rk,s}$	[kN]	29	46	67	126	196	282	367	449
Steel class 10.9	$N_{Rk,s}$	[kN]	37	58	84	157	245	353	459	561
Stainless steel A2, A4, HCR class 50	$N_{Rk,s}$	[kN]	18	29	42	78	122	176	229	280
Stainless steel A2, A4, HCR class 70	$N_{Rk,s}$	[kN]	26	41	59	110	171	247	321	392
Stainless steel A4, HCR class 80	$N_{Rk,s}$	[kN]	29	46	67	126	196	282	367	449
<b>Steel failure – characteristic tension resistance – partial factor</b>										
Steel class 4.8	$\gamma_{Ms,N}^{1)}$	[-]				1,50				
Steel class 5.8	$\gamma_{Ms,N}^{1)}$	[-]				1,50				
Steel class 8.8	$\gamma_{Ms,N}^{1)}$	[-]				1,50				
Steel class 10.9	$\gamma_{Ms,N}^{1)}$	[-]				1,40				
Stainless steel A2, A4, HCR class 50	$\gamma_{Ms,N}^{1)}$	[-]				2,86				
Stainless steel A2, A4, HCR class 70	$\gamma_{Ms,N}^{1)}$	[-]				1,87				
Stainless steel A4, HCR class 80	$\gamma_{Ms,N}^{1)}$	[-]				1,60				
<b>Steel failure – characteristic shear resistance without lever arm</b>										
Steel class 4.8	$V_{Rk,s}^0$	[kN]	7	12	17	31	49	71	92	112
Steel class 5.8	$V_{Rk,s}^0$	[kN]	9	14	21	39	61	88	115	140
Steel class 8.8	$V_{Rk,s}^0$	[kN]	15	23	34	63	98	141	184	224
Steel class 10.9	$V_{Rk,s}^0$	[kN]	18	29	42	78	122	176	230	280
Stainless steel A2, A4, HCR class 50	$V_{Rk,s}^0$	[kN]	9	14	21	39	61	88	115	140
Stainless steel A2, A4, HCR class 70	$V_{Rk,s}^0$	[kN]	13	20	29	55	86	124	160	196
Stainless steel A4, HCR class 80	$V_{Rk,s}^0$	[kN]	15	23	34	63	98	141	184	224
<b>Steel failure – characteristic shear resistance with lever arm</b>										
Steel class 4.8	$M_{Rk,s}^0$	[Nm]	15	30	52	133	260	449	666	900
Steel class 5.8	$M_{Rk,s}^0$	[Nm]	19	37	65	166	324	561	832	1125
Steel class 8.8	$M_{Rk,s}^0$	[Nm]	30	60	105	266	519	898	1331	1799
Steel class 10.9	$M_{Rk,s}^0$	[Nm]	37	75	131	333	649	1123	1664	2249
Stainless steel A2, A4, HCR class 50	$M_{Rk,s}^0$	[Nm]	19	37	66	166	324	561	832	1124
Stainless steel A2, A4, HCR class 70	$M_{Rk,s}^0$	[Nm]	26	52	92	233	454	786	1165	1574
Stainless steel A4, HCR class 80	$M_{Rk,s}^0$	[Nm]	30	60	105	266	519	898	1331	1799
<b>Steel failure – characteristic shear resistance – partial factor</b>										
Steel class 4.8	$\gamma_{Ms,V}^{1)}$	[-]				1,25				
Steel class 5.8	$\gamma_{Ms,V}^{1)}$	[-]				1,25				
Steel class 8.8	$\gamma_{Ms,V}^{1)}$	[-]				1,25				
Steel class 10.9	$\gamma_{Ms,V}^{1)}$	[-]				1,50				
Stainless steel A2, A4, HCR class 50	$\gamma_{Ms,V}^{1)}$	[-]				2,38				
Stainless steel A2, A4, HCR class 70	$\gamma_{Ms,V}^{1)}$	[-]				1,56				
Stainless steel A4, HCR class 80	$\gamma_{Ms,V}^{1)}$	[-]				1,33				

Fracture elongation threaded rod for seismic category C1 and C2 must be  $A_5 \geq 19\%$ .

Steel classes 10.9 are not covered for seismic application.

<sup>1)</sup> In the absence of national regulation


**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Performances**

Characteristic values for steel tension resistance and steel shear resistance  
- threaded rods

**Annex C1**  
of European  
Technical Assessment  
ETA-10/0102

**Table C2: Characteristic values tension resistance load in non-cracked concrete for threaded rod under static and quasi-static loads.**

Size			M8	M10	M12	M16	M20	M24	M27	M30
Steel failure										
Characteristic resistance	$N_{Rk,s}$	[kN]	See Annex C1 – Table C1							
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	See Annex C1 – Table C1							
Combined pull-out and concrete cone failure in non-cracked concrete C20/25										
Characteristic bond resistance temperature range -40°C / +40°C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	16,0	12,0	12,0	12,0	9,5	9,5	8,0	8,0
Characteristic bond resistance temperature range -40°C / +80°C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	11,0	8,5	8,5	8,5	7,0	7,0	6,0	6,0
Characteristic bond resistance temperature range -40°C / +120°C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	6,0	4,5	4,5	4,5	4,0	4,0	3,0	3,0
Increasing factor for C30/37	$\psi_c$	[-]	1,12							
Increasing factor for C40/50			1,23							
Increasing factor for C50/60			1,30							
Concrete cone failure										
Factor for non-cracked concrete	$k_{ucr,N}$	[-]	11,0							
Edge distance	$C_{cr,N}$	[mm]	$1,5 \cdot h_{ef}$							
Spacing	$S_{cr,N}$	[mm]	$3,0 \cdot h_{ef}$							
Splitting failure										
Edge distance	$C_{cr,Nsp}$	[mm]	If $h = h_{min}$							
			$2,5 \cdot h_{ef}$	$2,0 \cdot h_{ef}$	$1,5 \cdot h_{ef}$					
			If $h_{min} < h < 2 \cdot h_{min}$							
										
			interpolate values							
			if $h \geq 2 \cdot h_{min}$							
Spacing	$S_{cr,Nsp}$	[mm]	$C_{cr,Np}$ $2 \cdot C_{cr,sp}$							
Installation factor for combined pull-out, concrete cone and splitting failure										
Installation factors for category I1 <sup>1)</sup>	$\gamma_{inst}$	[-]	1,0							
Installation factors for category I2 <sup>1)</sup>			1,2							

<sup>1)</sup> In the absence of national regulation


DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES

**Performances**

Characteristic values tension resistance load in non-cracked concrete for threaded rod under static and quasi-static loads

**Annex C2**  
of European  
Technical Assessment  
ETA-10/0102

**Table C3: Characteristic values tension resistance load in cracked concrete for threaded rod under static and quasi-static loads.**

Size			M10	M12	M16	M20
Steel failure						
Characteristic resistance	$N_{Rk,s}$	[kN]	See Annex C1 – Table C1			
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	See Annex C1 – Table C1			
Combined pull-out and concrete cone failure in cracked concrete C20/25						
Characteristic bond resistance temperature range -40°C / +40°C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	9,0	9,0	9,0	6,5
Characteristic bond resistance temperature range -40°C / +80°C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	6,5	6,5	6,5	4,5
Characteristic bond resistance temperature range -40°C / +120°C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	3,5	3,5	3,5	2,5
Increasing factor for C30/37	$\psi_c$	[-]	1,12			
Increasing factor for C40/50			1,23			
Increasing factor for C50/60			1,30			
Concrete cone failure						
Factor for cracked concrete	$k_{cr,N}$	[-]	7,7			
Edge distance	$C_{cr,N}$	[mm]	$1,5 \cdot h_{ef}$			
Spacing	$S_{cr,N}$	[mm]	$3,0 \cdot h_{ef}$			
Splitting failure						
Edge distance	$C_{cr,Nsp}$	[mm]	If $h = h_{min}$			
			$2,5 \cdot h_{ef}$	$2,0 \cdot h_{ef}$	$1,5 \cdot h_{ef}$	
			If $h_{min} < h < 2 \cdot h_{min}$			
						
			interpolate values			
			if $h \geq 2 \cdot h_{min}$			
Spacing	$S_{cr,Nsp}$	[mm]	$C_{cr,Np}$ $2 \cdot C_{cr,sp}$			
Installation factor for combined pull-out, concrete cone and splitting failure						
Installation factors for category I1 <sup>1)</sup>	$\gamma_{inst}$	[-]	1,0			
Installation factors for category I2 <sup>1)</sup>			1,2			

<sup>1)</sup> In the absence of other national regulation

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Performances**

Characteristic values tension resistance load in cracked concrete for threaded rod under static and quasi-static loads

**Annex C3**  
of European  
Technical Assessment  
ETA-10/0102

**Table C4: Characteristic values shear resistance load – non-cracked and cracked concrete for threaded rod under static and quasi-static loads.**

Size			M8	M10	M12	M16	M20	M24	M27	M30	
Steel failure without lever arm											
Characteristic resistance	$V_{Rk,s}^0$	[kN]	See Annex C1 – Table C1								
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	See Annex C1 – Table C1								
Ductility factor	$k_7$	[-]	1,0								
Steel failure with lever arm											
Characteristic resistance	$M_{Rk,s}^0$	[kN]	See Annex C1 – Table C1								
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	See Annex C1 – Table C1								
Concrete pry out failure											
Factor	$k_8$	[-]	2,0								
Installation factor	$\gamma_{inst}$	[-]	1,0								
Concrete edge failure											
Effective length of anchor under shear loading	$l_f$	[-]	$l_f = h_{ef} \text{ and } \leq 12 d_{nom}$							$l_f = h_{ef} \text{ and } \leq \max(8 d_{nom}, 300 \text{ mm})$	
Installation factor	$\gamma_{inst}$	[-]	1,0								

<sup>1)</sup> In the absence of other national regulation


**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Performances**

Characteristic values shear resistance load – non- cracked and cracked concrete for threaded rod under static and quasi-static loads.

**Annex C4**  
of European  
Technical Assessment  
ETA-10/0102

**Table C5: Characteristic values tension resistance load in non-cracked concrete for rebar under static and quasi-static loads.**

Size			Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø28	Ø32
Steel failure											
Characteristic resistance	N <sub>Rk,s</sub>	[kN]	A <sub>s</sub> x f <sub>uk</sub> <sup>2)</sup>								
Cross section area	A <sub>s</sub>	[mm <sup>2</sup> ]	50	79	113	154	201	314	491	616	804
Partial factor	γ <sub>Ms,N</sub> <sup>1)</sup>	[-]	1,4								
Combined pull-out and concrete cone failure in non cracked concrete C20/25											
Characteristic bond resistance temperature range -40°C / +40°C	τ <sub>Rk,ucr</sub>	[N/mm <sup>2</sup> ]	14,0	13,0	13,0	12,0	10,0	9,5	9,5	8,5	7,5
Characteristic bond resistance temperature range -40°C / +80°C	τ <sub>Rk,ucr</sub>	[N/mm <sup>2</sup> ]	10,0	9,5	9,0	9,0	7,5	7,0	7,0	6,0	5,5
Characteristic bond resistance temperature range -40°C / +120°C	τ <sub>Rk,ucr</sub>	[N/mm <sup>2</sup> ]	5,5	5,0	5,0	5,0	4,0	4,0	4,0	3,5	3,0
Increasing factor for C30/37	ψ <sub>c</sub>	[-]	1,12								
Increasing factor for C40/50			1,23								
Increasing factor for C50/60			1,30								
Concrete cone failure											
Factor for non-cracked concrete	k <sub>ucr,N</sub>	[-]	11,0								
Edge distance	C <sub>cr,N</sub>	[mm]	1,5 · h <sub>ef</sub>								
Spacing	S <sub>cr,N</sub>	[mm]	3,0 · h <sub>ef</sub>								
Splitting failure											
Edge distance	C <sub>cr,Nsp</sub>	[mm]	If h = h <sub>min</sub>								
			2,5 · h <sub>ef</sub>			2,0 · h <sub>ef</sub>			1,5 · h <sub>ef</sub>		
			If h <sub>min</sub> < h < 2 · h <sub>min</sub>								
											
			interpolate values								
			if h ≥ 2 · h <sub>min</sub>								
Spacing	S <sub>cr,Nsp</sub>	[mm]	C <sub>cr,Np</sub> 2 · C <sub>cr,sp</sub>								
Installation factor for combined pull-out, concrete cone and splitting failure											
Installation factors for category I1 <sup>1)</sup>	γ <sub>inst</sub>	[-]	1,0								
Installation factors for category I2 <sup>1)</sup>			1,2								

<sup>1)</sup> In the absence of other national regulation<sup>2)</sup>  $f_{uk}$  shall be taken from the specifications of reinforcing bars

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Annex C5**  
of European  
Technical Assessment  
ETA-10/0102

**Performances**

Characteristic values tension resistance load in non-cracked concrete for rebar under static and quasi-static loads.

**Table C6: Characteristic values shear resistance load – non-cracked concrete for rebar under static and quasi-static loads.**

Size			Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø28	Ø32	
Steel failure without lever arm												
Characteristic resistance	$V_{Rk,s}^0$	[kN]	$0,5 \times A_s \times f_{uk}^{2)}$									
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,5									
Cross section area	$A_s$	[mm <sup>2</sup> ]	50	79	113	154	201	314	491	616	804	
Ductility factor	$k_7$	[-]	1,0									
Steel failure with lever arm												
Characteristic resistance	$M_{Rk,s}^0$	[kN]	$1,2 \times W_{el} \times f_{uk}^{2)}$									
Elastic section modulus	$W_{el}$	[mm <sup>3</sup> ]	50	98	170	269	402	785	1534	2155	3217	
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,5									
Concrete pry out failure												
Factor	$k_8$	[-]	2,0									
Installation factor	$\gamma_{inst}$	[-]	1,0									
Concrete edge failure												
Effective length of anchor under shear loading	$l_f$	[-]	$l_f = h_{ef} \text{ and } \leq 12 d_{nom}$							$l_f = h_{ef} \text{ and } \leq \max(8 d_{nom,i}; 300 \text{ mm})$		
Installation factor	$\gamma_{inst}$	[-]	1,0									

<sup>1)</sup> In the absence of other national regulation<sup>2)</sup>  $f_{uk}$  shall be taken from the specifications of reinforcing bars

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Performances**

Characteristic values shear resistance load – non-cracked concrete for rebar under static and quasi-static loads.

**Annex C6**  
of European  
Technical Assessment  
ETA-10/0102

**Table C7: Displacement under tension loads for non-cracked concrete – threaded rods under static and quasi-static loads.**

Size			M8	M10	M12	M16	M20	M24	M27	M30
Characteristic displacement in non-cracked concrete C20/25 to C50/60 under tension loads										
Service load <sup>1)</sup>	F	[kN]	9,6	10,8	14,3	23,8	29,6	42,4	40,4	44,4
Displacement	$\delta_{N0}$	[mm]	0,30	0,30	0,35	0,35	0,35	0,40	0,40	0,45
	$\delta_{N\infty}$	[mm]	0,85	0,85	0,85	0,85	0,85	0,85	0,85	0,85

**Table C8: Displacement under tension loads for non-cracked concrete – threaded rods under static and quasi-static loads.**

Size			M10	M12	M16	M20
Characteristic displacement in cracked concrete C20/25 to C50/60 under tension loads						
Service load <sup>1)</sup>	F	[kN]	9,5	14,3	21,4	23,8
Displacement	$\delta_{N0}$	[mm]	0,50	0,50	0,70	0,60
	$\delta_{N\infty}$	[mm]	0,85	0,85	0,85	0,85

**Table C9: Displacement under shear loads for non-cracked and cracked concrete – threaded rods under static and quasi-static loads.**

Size			M8	M10	M12	M16	M20	M24	M27	M30
Characteristic displacement in cracked and non-cracked concrete C20/25 to C50/60 under shear loads										
Service load <sup>1)</sup>	F	[kN]	3,7	5,8	8,4	15,7	24,5	35,3	45,5	55,6
Displacement	$\delta_{V0}$	[mm]	2,0	2,0	2,0	2,0	2,0	2,0	2,0	2,0
	$\delta_{V\infty}$	[mm]	3,0	3,0	3,0	3,0	3,0	3,0	3,0	3,0

**Table C10: Displacement under tension loads for non-cracked concrete – rebar under static and quasi-static loads.**

Size			Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø28	Ø32
Characteristic displacement in non-cracked concrete C20/25 to C50/60 under tension loads											
Service load <sup>1)</sup>	F	[kN]	10,1	13,6	17,2	20,1	23,9	41,2	53,3	64,1	67,3
Displacement	$\delta_{N0}$	[mm]	0,33	0,33	0,40	0,41	0,42	0,45	0,45	0,47	0,48
	$\delta_{N\infty}$	[mm]	0,85	0,85	0,85	0,85	0,85	0,85	0,85	0,85	0,85

**Table C11: Displacement under shear loads for non-cracked concrete – rebar under static and quasi-static loads.**

Size			Ø8	Ø10	Ø12	Ø14	Ø16	Ø20	Ø25	Ø28	Ø32
Characteristic displacement in non-cracked concrete C20/25 to C50/60 under shear loads											
Service load <sup>1)</sup>	F	[kN]	13,2	20,6	29,6	40,3	52,7	82,3	128,6	161,3	210,6
Displacement	$\delta_{V0}$	[mm]	2,0	2,0	2,0	2,0	2,0	2,0	2,0	2,0	2,0
	$\delta_{V\infty}$	[mm]	3,0	3,0	3,0	3,0	3,0	3,0	3,0	3,0	3,0

<sup>1)</sup> These values are suitable for each temperature range and categories specified in Annex B1

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Performances**  
Displacement under service loads

**Annex C7**  
of European  
Technical Assessment  
ETA-10/0102

**Table C12: Characteristic values tension resistance load for threaded rod for seismic performance category C1.**

Size			M12	M16	M20
Steel failure					
Characteristic resistance	$N_{Rk,s,eq,C1}$	[kN]	1,0 x $N_{Rk,s}$		
Partial factor <sup>1)</sup>	$\gamma_{Ms,N}^{1)}$	[-]	See Annex C1 – Table C1		
Combined pull-out and concrete cone failure					
Characteristic bond resistance temperature range -40°C / +40°C	$\tau_{Rk,C1}$	[N/mm <sup>2</sup> ]	4,2	3,7	3,7
Characteristic bond resistance temperature range -40°C / +80°C	$\tau_{Rk,C1}$	[N/mm <sup>2</sup> ]	3,0	2,7	2,7
Characteristic bond resistance temperature range -40°C / +120°C	$\tau_{Rk,C1}$	[N/mm <sup>2</sup> ]	1,6	1,4	1,4
Increasing factor for C30/37	$\psi_c$	[-]	1,0		
Increasing factor for C40/50					
Increasing factor for C50/60					
Installation factors for category I1 <sup>1)</sup>	$\gamma_{inst}$	[-]	1,0		
Installation factors for category I2 <sup>1)</sup>			1,2		

<sup>1)</sup> In the absence of other national regulation**Table C13: Characteristic values shear resistance load for threaded rod for seismic performance category C1.**

Size			M12	M16	M20
<b>Steel failure</b>					
Characteristic resistance	$V_{Rk,s,eq,C1}$	[kN]	$0,7 \times V_{Rk,s}^0$		
Partial factor <sup>1)</sup>	$\gamma_{Ms,V}$	[-]	See Annex C1 – Table C1		

<sup>1)</sup> In the absence of other national regulation**Table C14: Reduction factor for annular gap.**

<b>Reduction factor for annular gap</b>			
Without annular gap filling	$\alpha_{gap}$	[-]	0,5
With annular gap filling	$\alpha_{gap}$	[-]	1,0

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Performances**

Characteristic resistance under tension and shear loads for threaded rod  
for seismic action category C1

**Annex C8**  
of European  
Technical Assessment  
ETA-10/0102

**Table C15: Characteristic values tension resistance load for threaded rod for seismic performance category C2.**

Size			M12	M16
Steel failure				
Characteristic resistance	$N_{Rk,s,eq,C2}$	[kN]	$1,0 \times N_{Rk,s}$	
Partial factor <sup>1)</sup>	$\gamma_{Ms,N}^{1)}$	[-]	See Annex C1 – Table C1	
Combined pull-out and concrete cone failure				
Characteristic bond resistance temperature range -40°C / +40°C	$\tau_{Rk,eq,C2}$	[N/mm <sup>2</sup> ]	1,6	1,7
Characteristic bond resistance temperature range -40°C / +80°C	$\tau_{Rk,eq,C2}$	[N/mm <sup>2</sup> ]	1,2	1,2
Characteristic bond resistance temperature range -40°C / +120°C	$\tau_{Rk,eq,C2}$	[N/mm <sup>2</sup> ]	0,6	0,7
Increasing factor for C30/37	$\psi_c$	[-]	1,0	
Increasing factor for C40/50				
Increasing factor for C50/60				
Installation factors for category I1 <sup>1)</sup>	$\gamma_{inst}$	[-]	1,0	
Installation factors for category I2 <sup>1)</sup>			1,2	

<sup>1)</sup> In the absence of other national regulation**Table C16: Characteristic values shear resistance load for threaded rod for seismic performance category C2.**

Size			M12	M16
<b>Steel failure</b>				
Characteristic shear resistance	$V_{Rk,s,eq,C2}$	[kN]	$0,53 \times V_{Rk,s}^0$	$0,46 \times V_{Rk,s}^0$
Partial factor <sup>1)</sup>	$\gamma_{Ms,V}$ <sup>1)</sup>	[-]	See Annex C1 – Table C1	

<sup>1)</sup> In the absence of other national regulation**Table C17: Reduction factor for annular gap.**

<b>Reduction factor for annular gap</b>				
Without annular gap filling	$\alpha_{gap}$	[-]	0,5	
With annular gap filling	$\alpha_{gap}$	[-]	1,0	

**Table C18: Displacements for tensile and shear load for seismic performance category C2 - threaded rod.**

Size			M12	M16
<b>Displacements for tensile and shear load for seismic performance category C2</b>				
Displacement in tensile at damage limitation states	$\delta_{N,eq,seis}(DLS)$	[mm]	0,20	0,23
Displacement in tensile at ultimate limit state	$\delta_{N,eq,seis}(ULS)$	[mm]	0,33	1,04
Displacement in shear at damage limitation states	$\delta_{V,eq,seis}(DLS)$	[mm]	2,01	0,70
Displacement in shear at ultimate limit state	$\delta_{V,eq,seis}(ULS)$	[mm]	4,68	2,12

**DGE 02 Sinto-ST-VE,  
DGE 12 Sinto-ST-VEW and DGE 22 Sinto-ST-VES**

**Performances**

Characteristic resistance under tension and shear loads for threaded rod  
for seismic performance category C2

**Annex C9**  
of European  
Technical Assessment  
ETA-10/0102

